




	STOP VALVE
	CHECK VALVE
	CIRCULATOR

TWO SSH HEATERS
PIPED IN PARALLEL TO
ONE STORAGE TANK

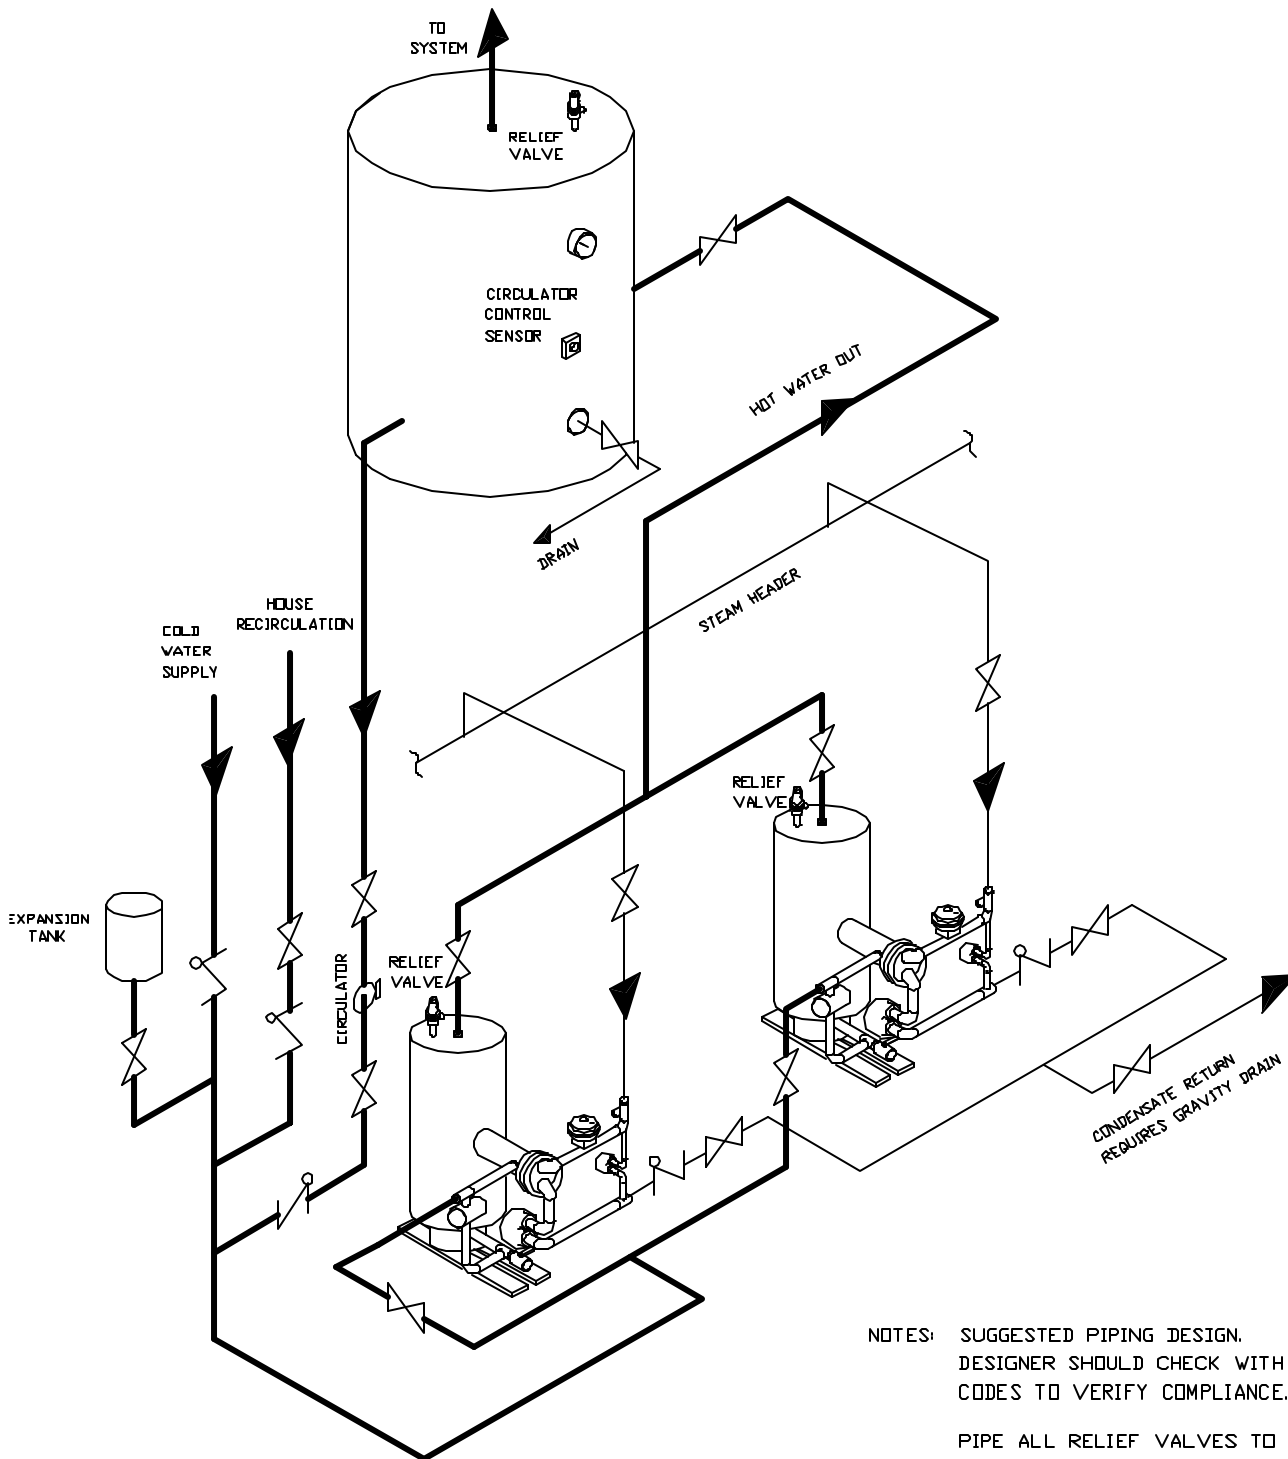

NOTES: SUGGESTED PIPING DESIGN.
DESIGNER SHOULD CHECK WITH LOCAL
CODES TO VERIFY COMPLIANCE.

PIPE ALL RELIEF VALVES TO DRAIN.