




ONE SEH HEATER PARALLEL PIPED TO TWO STORAGE TANKS

| | |
|--|-------------|
| | STOP VALVE |
| | CHECK VALVE |
| | CIRCULATOR |

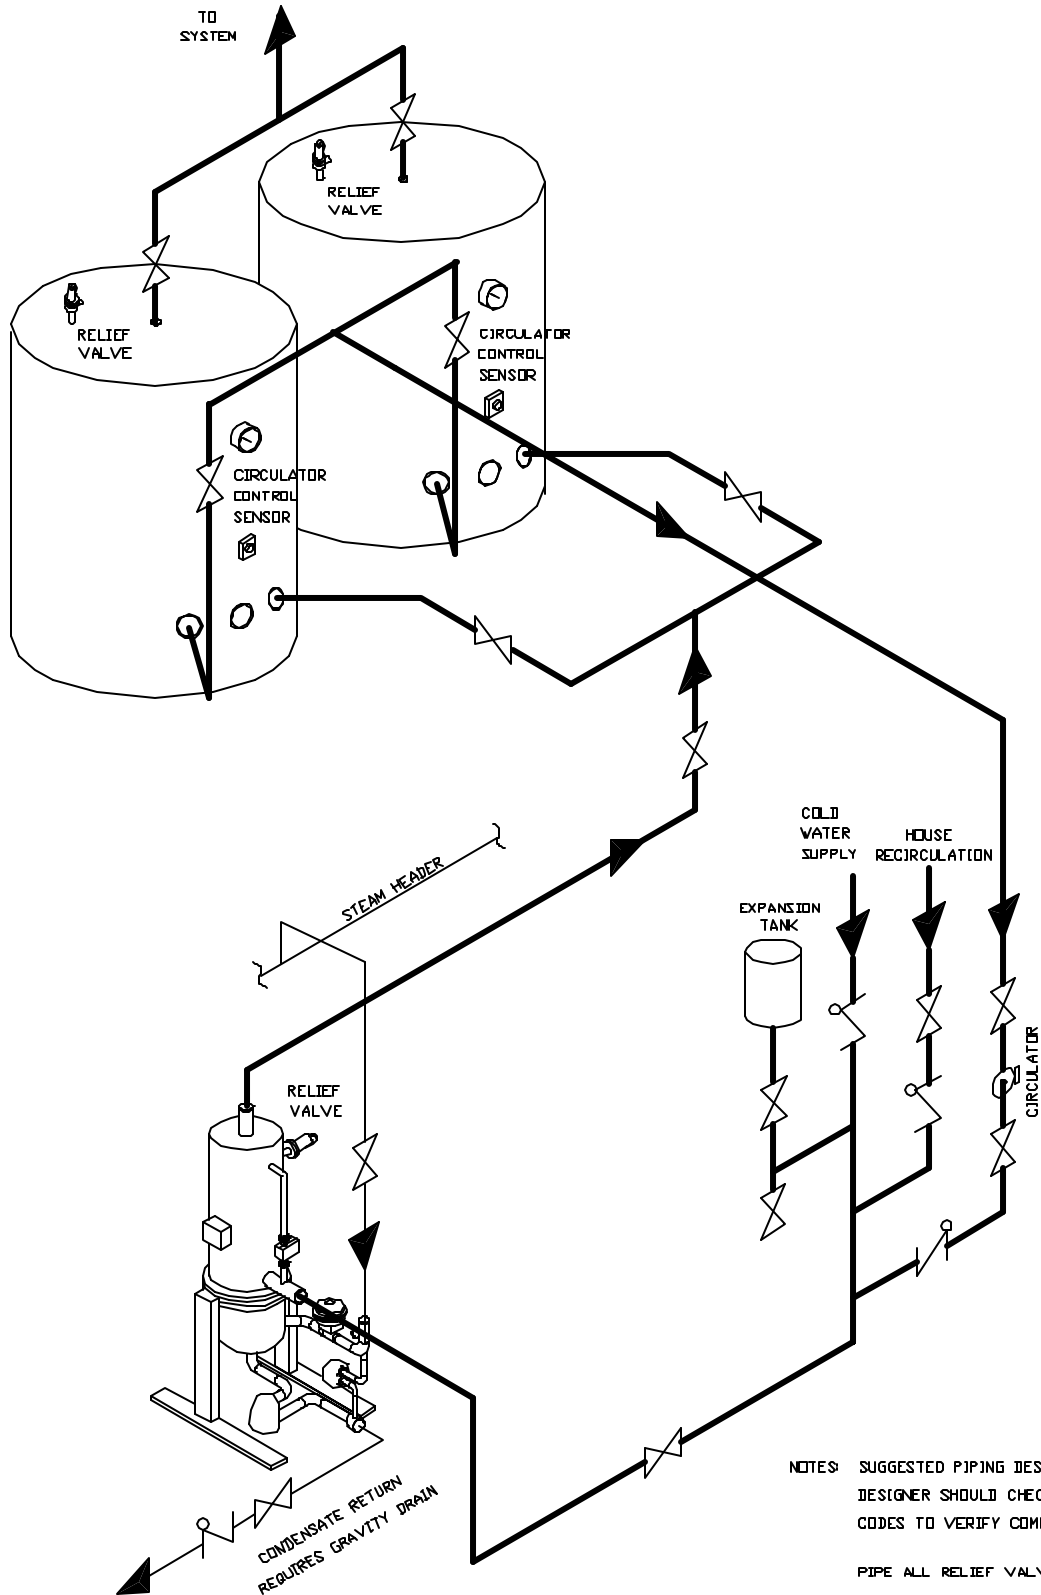

NOTES: SUGGESTED PIPING DESIGN
DESIGNER SHOULD CHECK WITH LOCAL
CODES TO VERIFY COMPLIANCE.

PIPE ALL RELIEF VALVES TO DRAIN